


\* DIMENSIONS MAY VARY IN ACTUAL INSTALLATION - FABRICATION CHANGES RESERVED - SIMILAR EQUIPMENT MAY BE SUBSTITUTED \*

FIRST DRAWN	BY
01-05-21	CJC
REVISED	BY


**COPYRIGHT © TURNSTILES.US**  
Copyright © Turnstiles.us All rights reserved. Reproduction or translation of this work without the express written permission of TURNSTILES.us is unlawful and is an infringement of intellectual property belonging to TURNSTILES.us.  
All drawings and/or designs are restricted for use exclusively with a purchase, installation, and/or support from Turnstiles.us. Any other use of these materials is a violation of copyright law. Request for additional information should be addressed to the Legal Department, Turnstiles.us.



[www.TURNSTILES.us](http://www.TURNSTILES.us)  
Call 303 670 1099 \* Text 303 918 9787  
patrick.mcallister@turnstiles.us

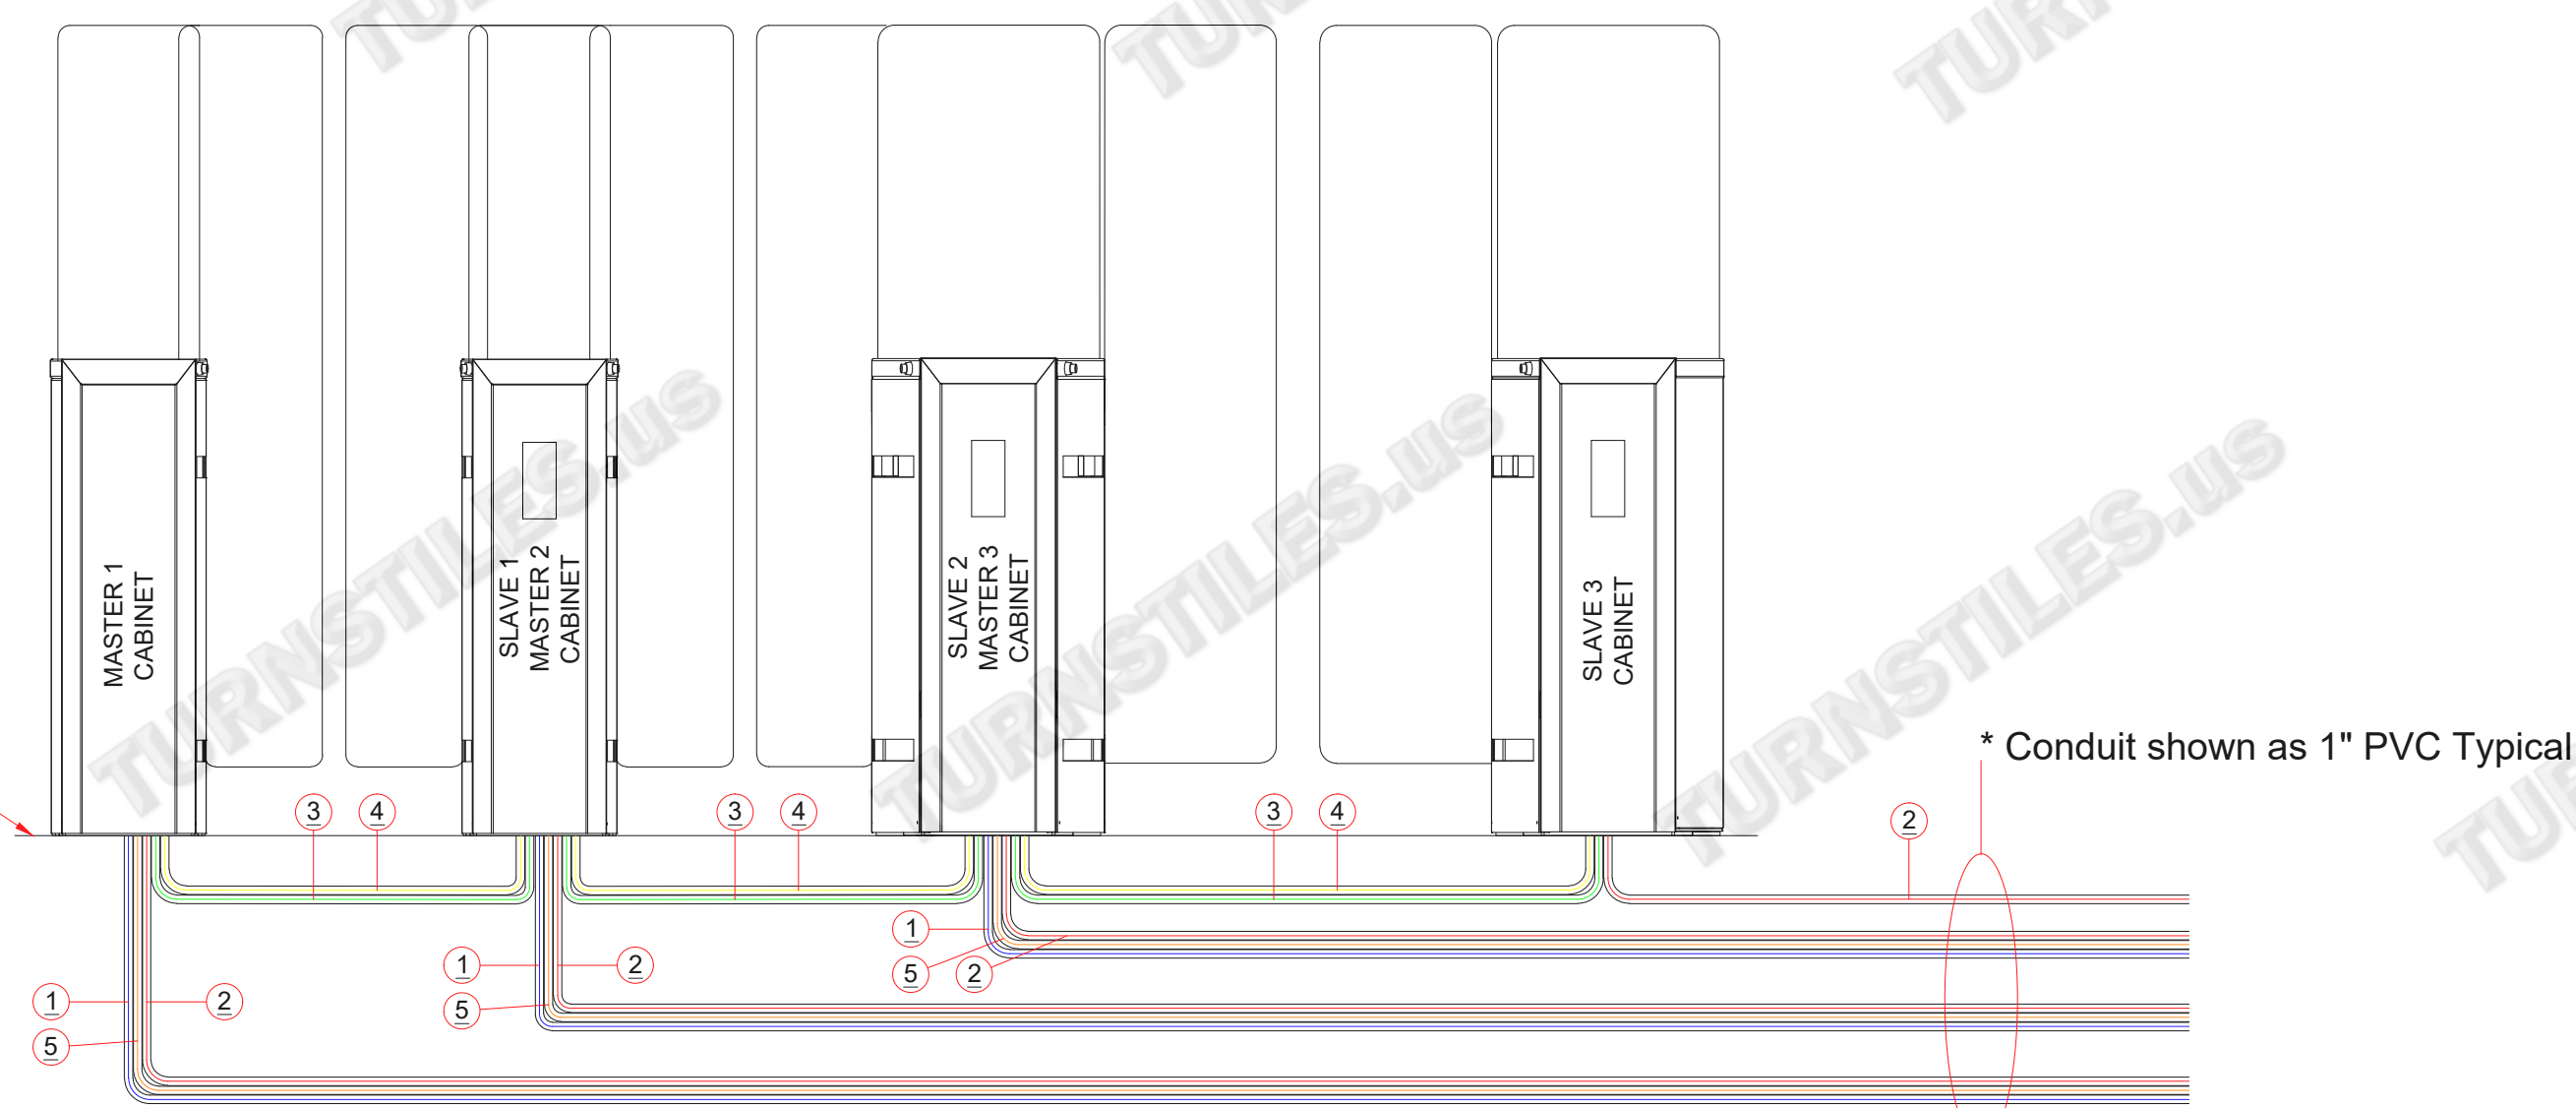

**WARNING!!!**  
Wires 3 and 4 must be fed through separate conduits.

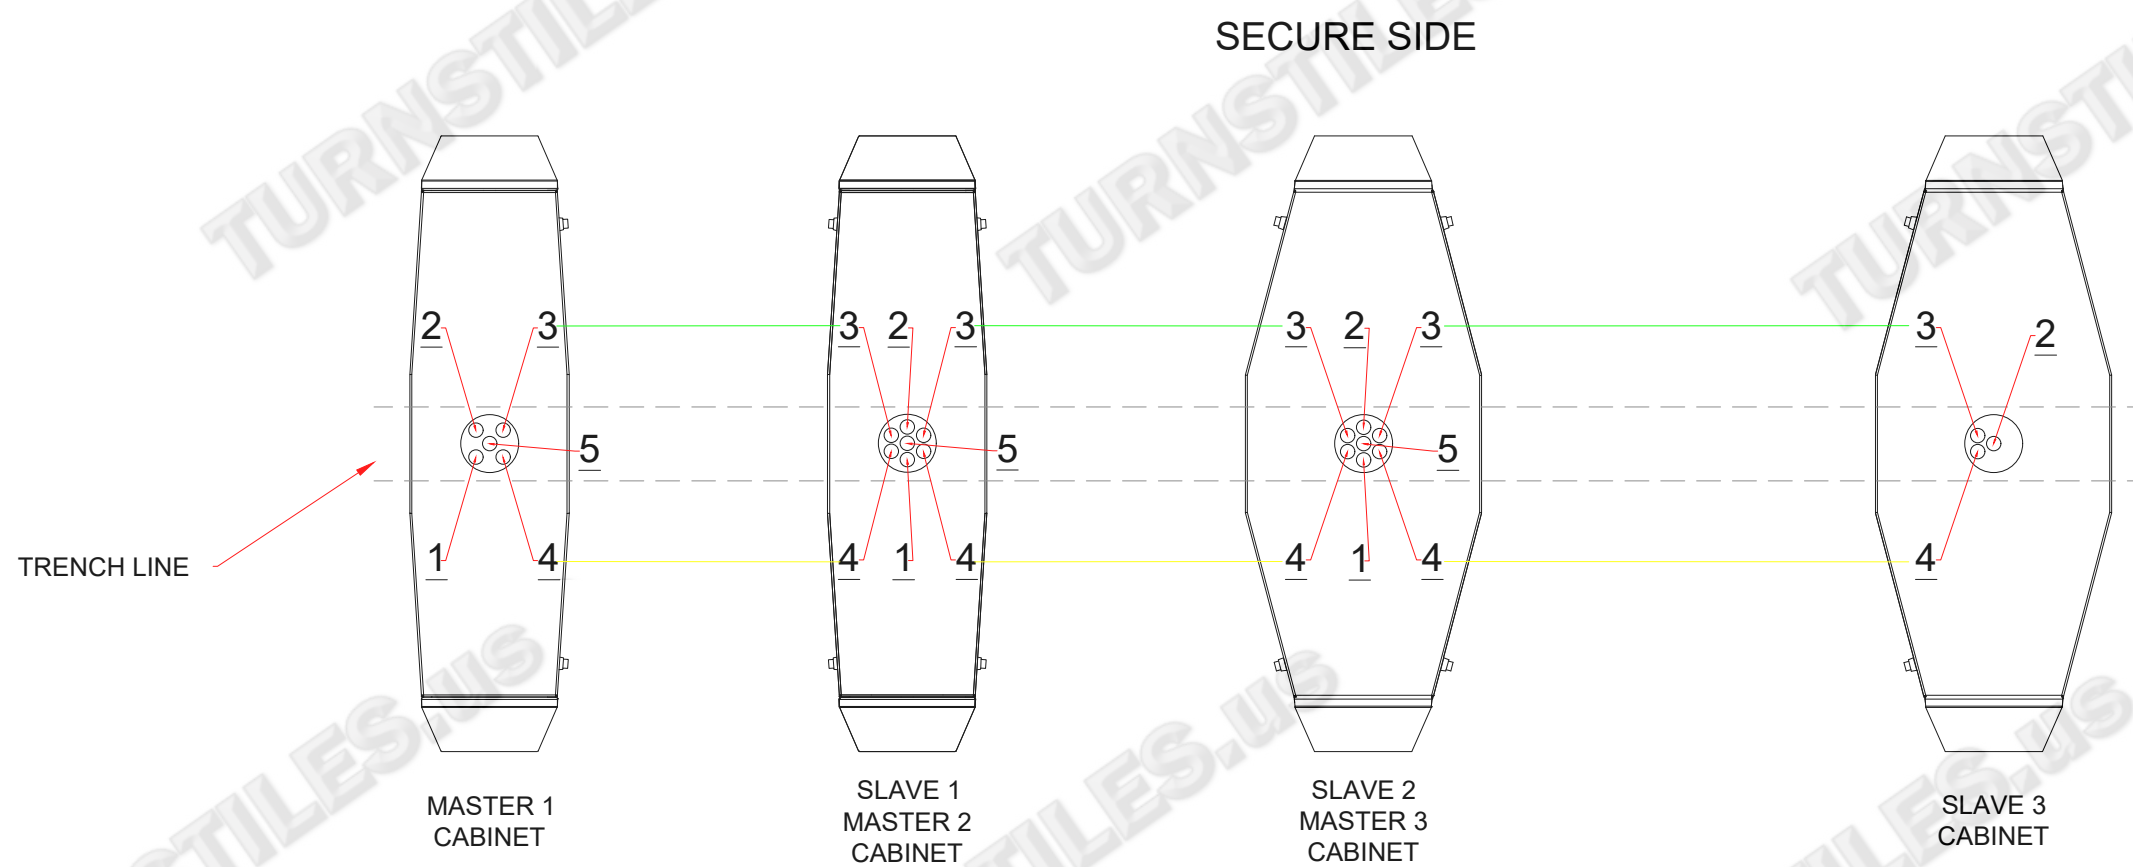

- 1** Power Supply 110V [230V] - 14-2 AWG (3 conductors)
- 2** Lock Controls - 18/2 AWG - and/or Card Reader Cable 24/6 AWG Typical
- 3 & 4 Wires delivered with the equipment.**
- 3** Connection of MASTER-SLAVE modules. Wire; 4G1mm2; shielded; PVC; gray; 300/500V; F-CY-JZ
- 4** Connection of MASTER-SLAVE modules. Cu; 7G0,5mm2; PVC; JZ-500; 300/500 V
- 5** Fire Alarm Control Panel (FACP) 18/2 AWG Typical

Equipment Anchor & Conduit Detail	
Bouten Construction Co. Selkirk Pharma Turnstiles GT1 & GT2 Series, High Glass Wiring & Conduit Detail	
DWG	01-05-21 Bouten Construction Co. Wiring Conduit Detail
DATE	01-05-21
SHEET - 1 OF 1	

AUTHORIZED SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_ / \_\_\_\_ / \_\_\_\_